


South Suburban Sanitary District Disconnection Valve Installation Standard

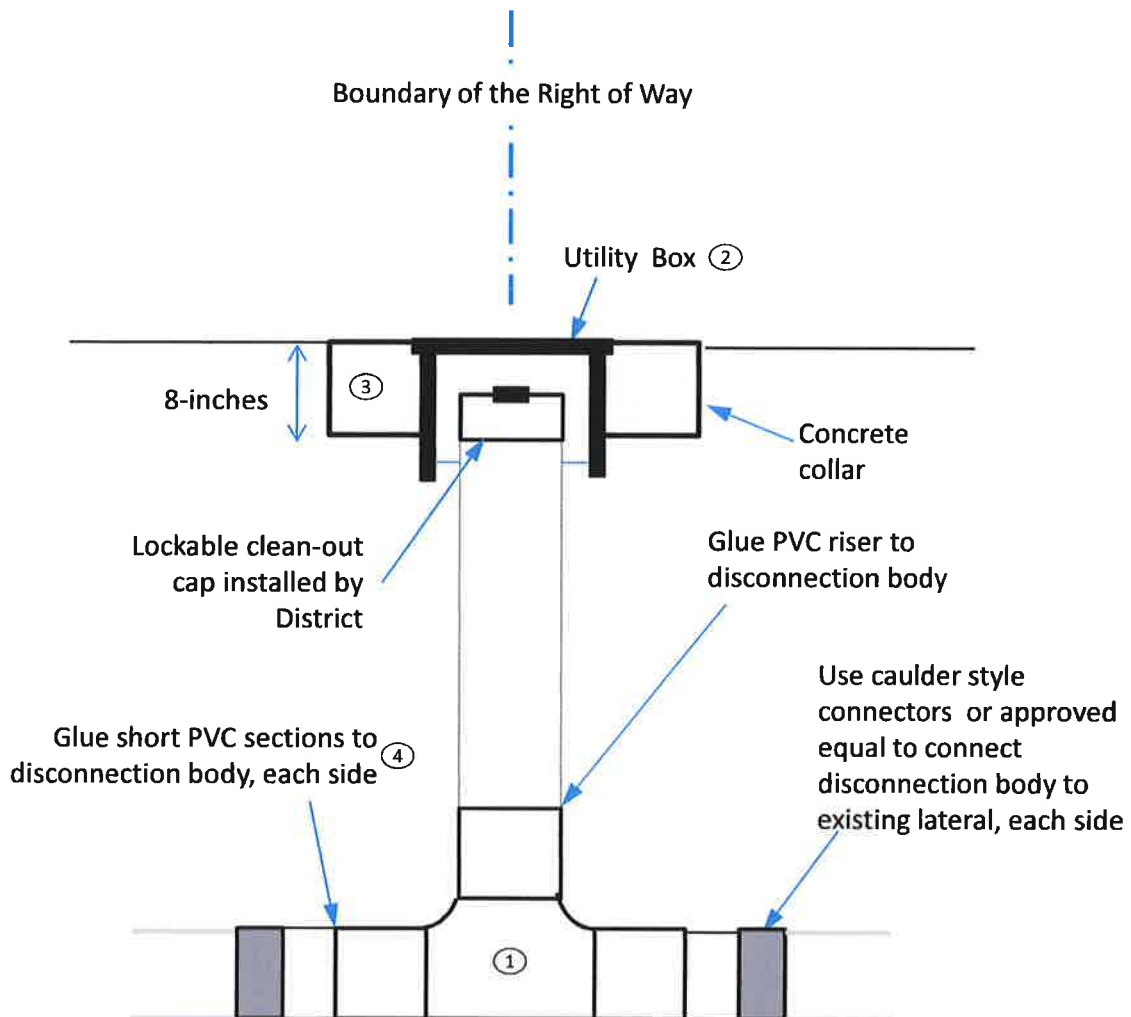

Notes:

1. The District shall supply the disconnection body and the lockable cleanout cap, all other materials are the responsibility of the property owner to procure
2. Utility Box shall be iron or concrete around pavement/parking areas. Carsonite style utility box may be substituted when located off of pavement/parking areas
3. Concrete collar required when located in paved/parking areas.
4. If existing lateral is PVC, one side of disconnection body may be glued directly to existing lateral
5. Please call 811 for all utility locates prior to excavation